
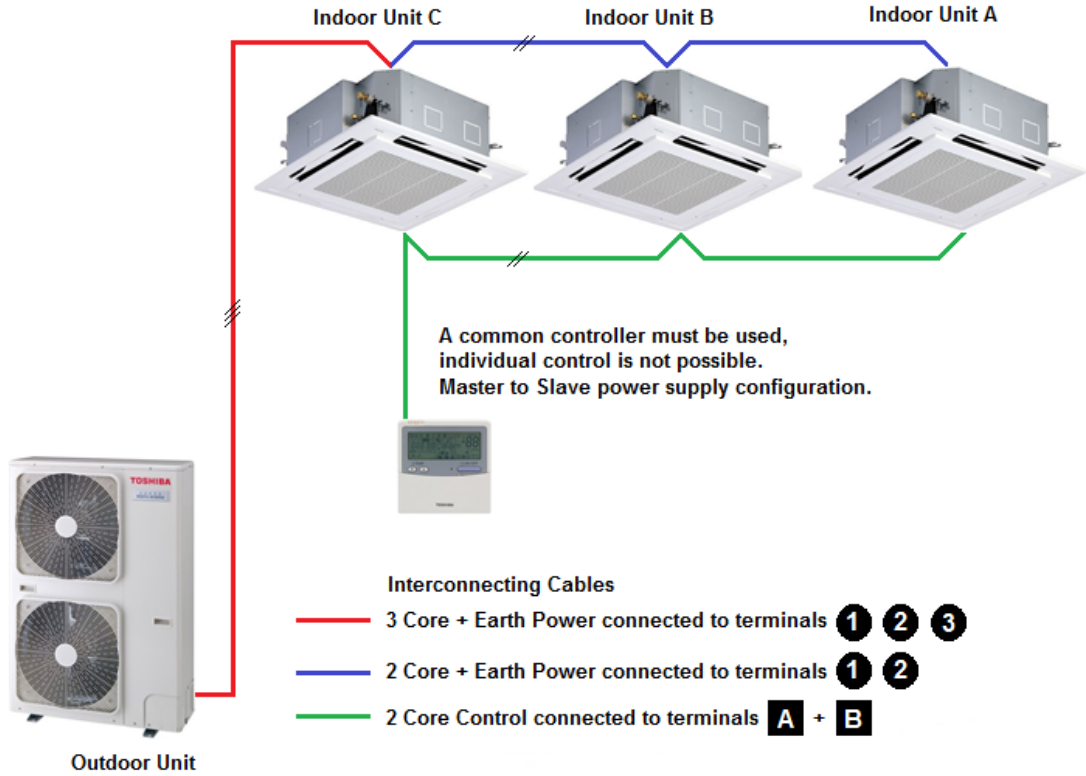


# Super Digital Inverter Triple Split System Piping & Wiring Schematics

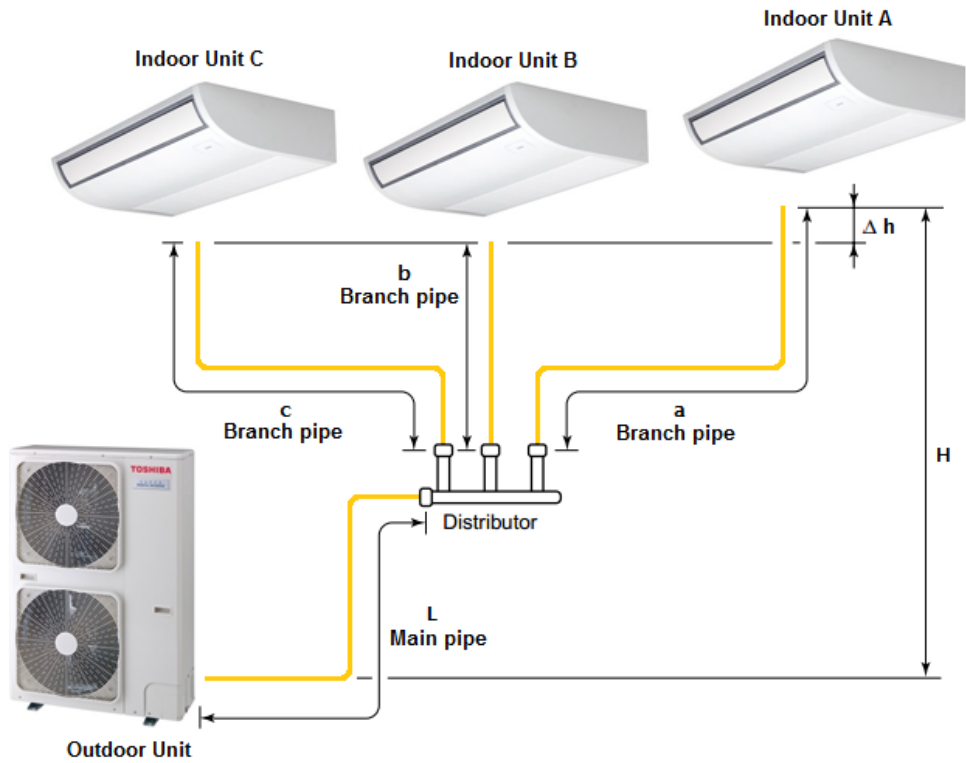

Model (RAV-)	Allowable Piping Length			Height Difference (m)		Number of Bent Portions Maximum or Less
	* Total Length La + Lb La + Lc Maximum	† Branch Piping a, b or c to Furthest Indoor Maximum	‡ Subtractive Piping Length b - a b - c Maximum	Indoor to Outdoor	Indoor to Indoor (Δh)	
SP1104AT(8)-E SP1404AT(8)-E SP1604AT8-E	50	15	10	±30	±0.5	10

\* Total length of pipe between furthest indoor and outdoor unit  
 † Maximum distance of Branch pipe from main pipe distributor to furthest indoor unit  
 ‡ Maximum subtractive distance between pipe branches